




PERPENDICULAR DRIVEWAY ①

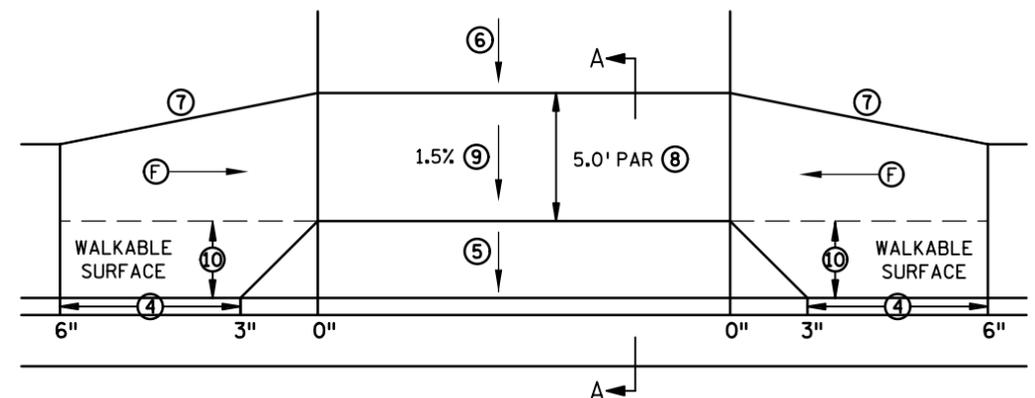


TIERED PERPENDICULAR OFFSET DRIVEWAY

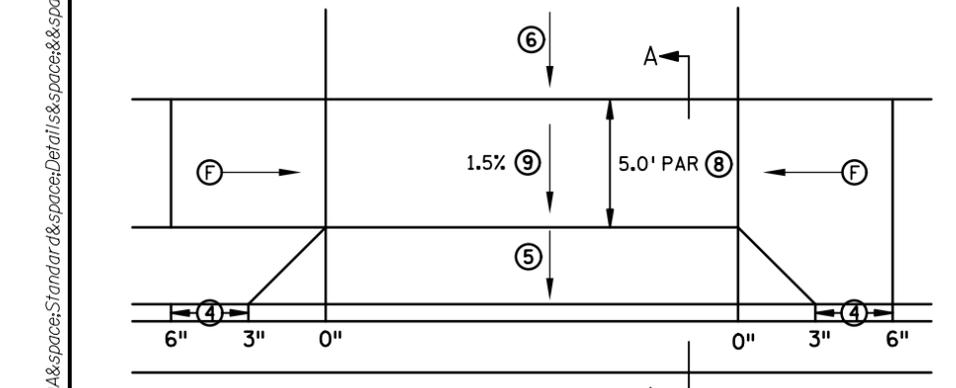


TIERED PERPENDICULAR DRIVEWAY ②

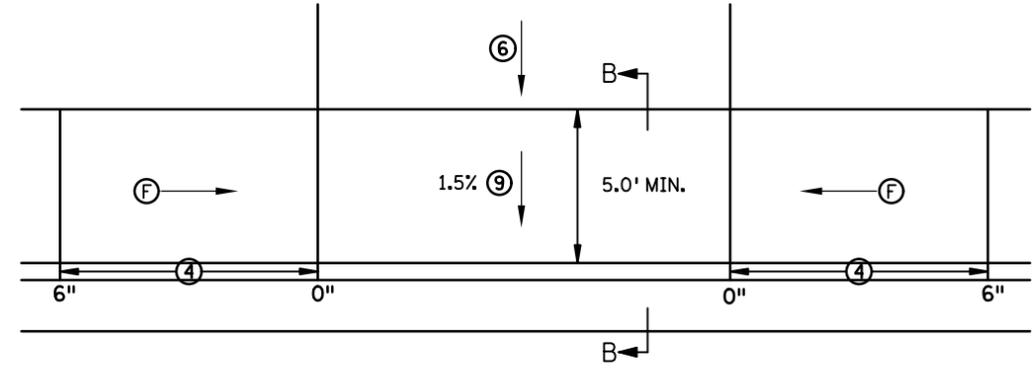


PARALLEL DRIVEWAY ③

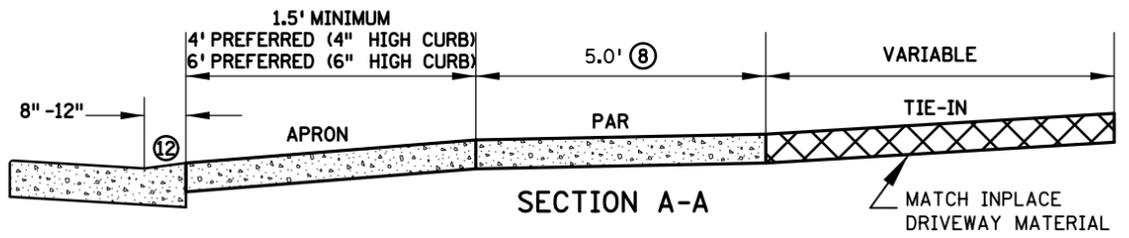


SECTION A-A

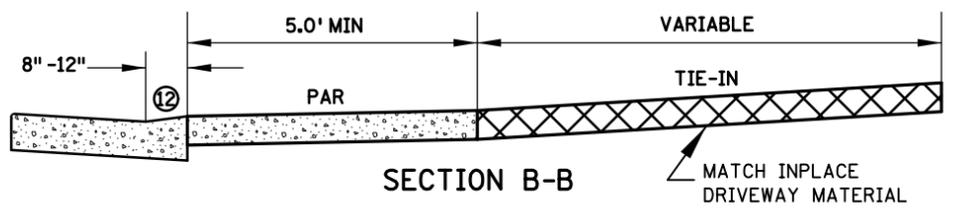

SECTION B-B

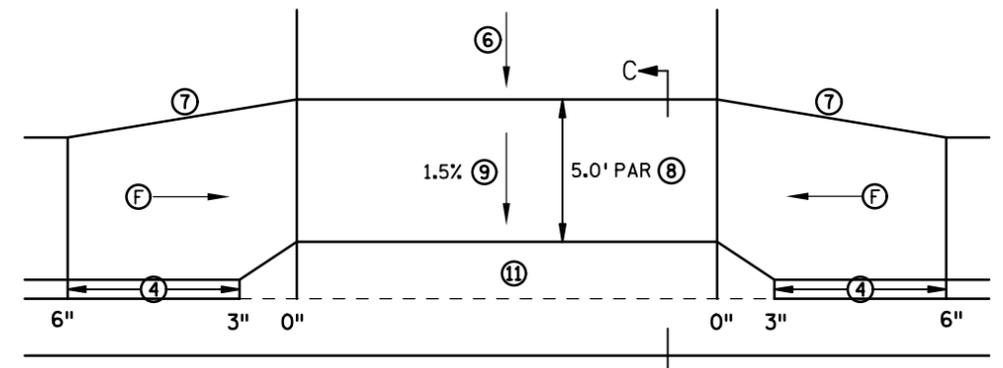

VALLEY GUTTER DRIVEWAY

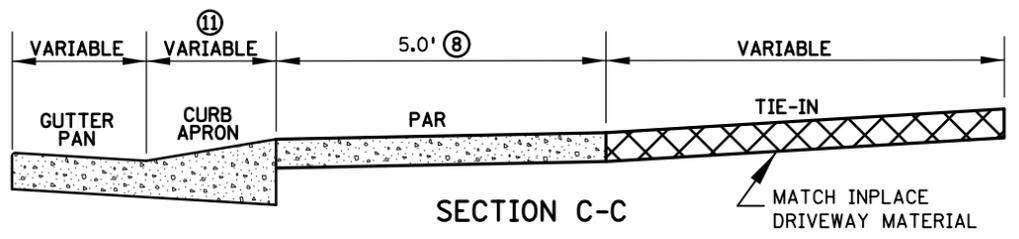

SECTION C-C

NOTES:

- IN NO CASE SHALL SIDEWALK PROFILES EXCEED 5.0%, EXCEPT SIDEWALK PROFILES CAN MATCH ROADWAY GRADE IF ROADWAY GRADE IS GREATER THAN 5.0%. RAMPS FOR DRIVEWAYS ARE REQUIRED TO FOLLOW THE ABOVE SIDEWALK CRITERIA.
- CONTRACTION JOINTS SHALL BE CONSTRUCTED ALONG ALL GRADE BREAKS WITHIN THE PEDESTRIAN ACCESS ROUTE (PAR). 1/4" DEEP VISUAL JOINTS SHALL BE USED AT THE TOPS OF CONCRETE FLARES ADJACENT TO WALKABLE SURFACES.
- DRIVEWAY TYPES FROM MOST PREFERRED TO LEAST PREFERRED ARE AS FOLLOWS: PERPENDICULAR, TIERED PERPENDICULAR, TIERED PERPENDICULAR OFFSET & PARALLEL.
- ① TO BE USED WHEN THE DRIVEWAY PAR IS LEVEL WITH OR ABOVE THE TOP OF CURB, RESULTING IN A CONTINUOUS PAR PROFILE.
- ② TO BE USED WHEN THE DRIVEWAY PAR IS BELOW THE ROADWAY CURB HEIGHT. THIS DRIVEWAY TYPE CAN BE USED FOR BOTH PAVED (AS SHOWN) AND GRASS BOULEVARDS.
- ③ SHOULD BE USED FOR NEGATIVE SLOPED DRIVEWAYS. DW CURB TYPE 2 CURB SHOULD BE USED TO RAISE PAR ABOVE GUTTER AND REDUCE "ROLLER COASTER" EFFECT. 4" HIGH ROADWAY CURB SHOULD BE USED TO REDUCE "ROLLER COASTER" EFFECT ESPECIALLY WHEN MULTIPLE DRIVEWAYS ARE PRESENT.
- ④ TOP OF CURB SHALL MATCH PROPOSED ADJACENT WALK GRADE.
- ⑤ 8% MAX. PREFERRED, 10% MAX. FOR COMMERCIAL AND 12% MAX. FOR RESIDENTIAL. SEE GENERAL NOTES ON SHEET 2 FOR MORE INFORMATION.
- ⑥ 8% MAX. PREFERRED, SEE SHEET 2 FOR MORE INFORMATION.
- ⑦ 1:3 MIN. 1:5 PREFERRED FOR DRIVEWAY RETROFIT PROJECTS. 1:10 PREFERRED FOR SIDEWALK REPLACEMENT PROJECTS.
- ⑧ 5.0' MIN. PAR WIDTH IS THE STANDARD THROUGH DRIVEWAYS. IF FEASIBLE WIDEN DRIVEWAY PAR WIDTH TO MATCH APPROACHING SIDEWALK PAR WIDTHS. IN VERTICALLY CONSTRAINED AREAS PAR WIDTHS CAN INCREMENTALLY BE REDUCED TO 4.5' OR 4' MIN AFTER ALL OTHER OPTIONS HAVE BEEN APPLIED.
- ⑨ THE PEDESTRIAN ACCESS ROUTE, MAY NOT EXCEED 0.02 FT./FT. AS CONSTRUCTED.
- ⑩ SIDEWALK OFFSET TO BE LESS THAN OR EQUAL TO HALF THE APPROACHING SIDEWALK WIDTH.
- ⑪ VALLEY GUTTER APRON TO BE POURED INTEGRAL WITH THE CURB AND GUTTER. SEE SHEET 2 FOR MORE INFORMATION.
- ⑫ SEE SHEET 2 FOR CURB TYPE INFORMATION.

LEGEND	
(F) ↓	INDICATES DRIVEWAY RAMP - SLOPE SHALL BE GREATER THAN 2.0% AND LESS THAN 5.0% IN THE DIRECTION SHOWN AND CROSS SLOPE SHALL NOT EXCEED 2.0%
X"	CURB HEIGHT (INCHES)

DISTRICT #: DISTRICT *
 USER NAME: \$\$\$@USER\$NAME\$\$\$
 PATH & FILENAME: Documents/Operations/ADA_Review/ADA_DesignGuidelines/ADA&space;Standard&space;Plates/2016&space;Cur&space;Ramp&space;Std.&space;

REVISION:

APPROVED: JANUARY 23, 2017

OPERATIONS ENGINEER

REVISOR:

APPROVED:

1-23-2017


STATE DESIGN ENGINEER

DRIVEWAY AND SIDEWALK DETAILS


STANDARD PLAN 5-297.254

1 OF 4


DISTRICT #: DISTRICT *
 USER NAME: \$\$\$@USER\$NAME@\$\$
 PATH & FILENAME: Documents/Operations/ADA_Review/ADA_DesignGuidelines/ADA&space;Standard&space;Plates/2016&space;Cur&space;Ramp&space;Std.&space;

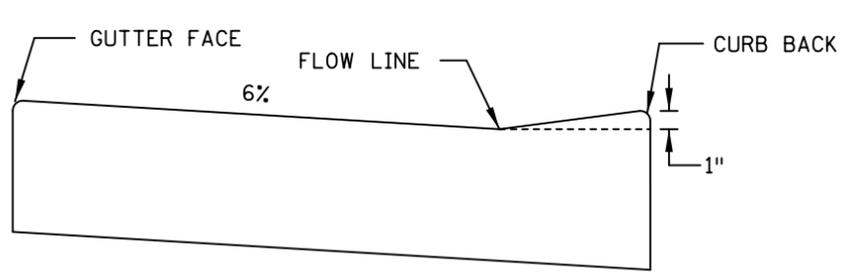


DW CURB STANDARD
STANDARD CURB AT DRIVEWAY

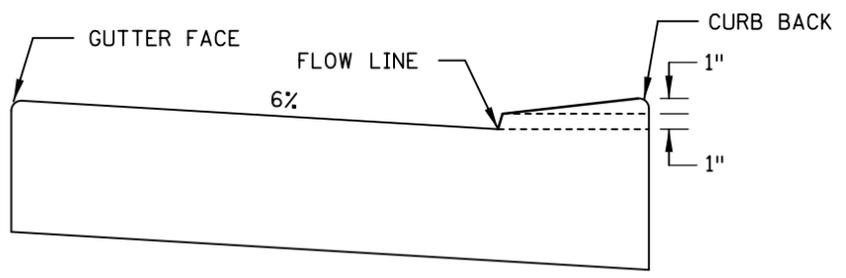


DW CURB TYPE 2
VERTICALLY CONSTRAINED

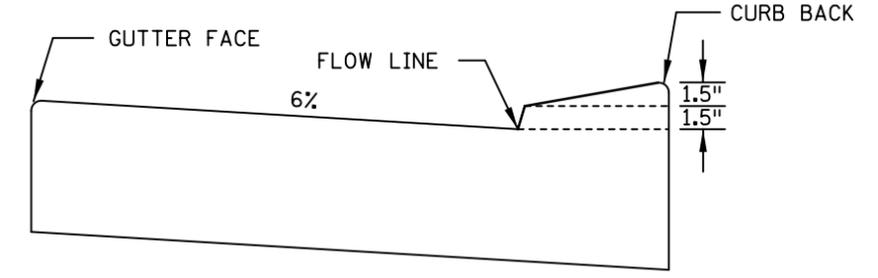


DW CURB TYPE 3
VERTICALLY CONSTRAINED

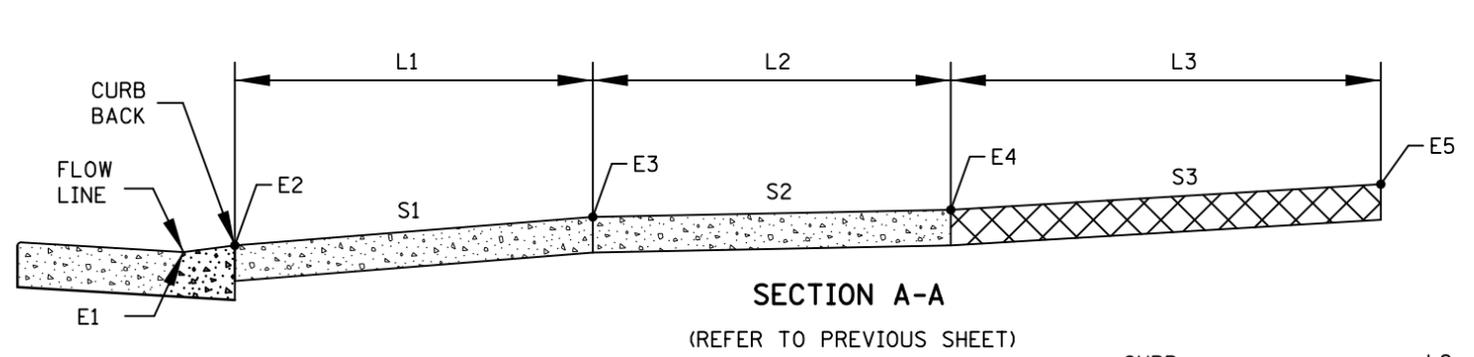

SECTION A-A
(REFER TO PREVIOUS SHEET)

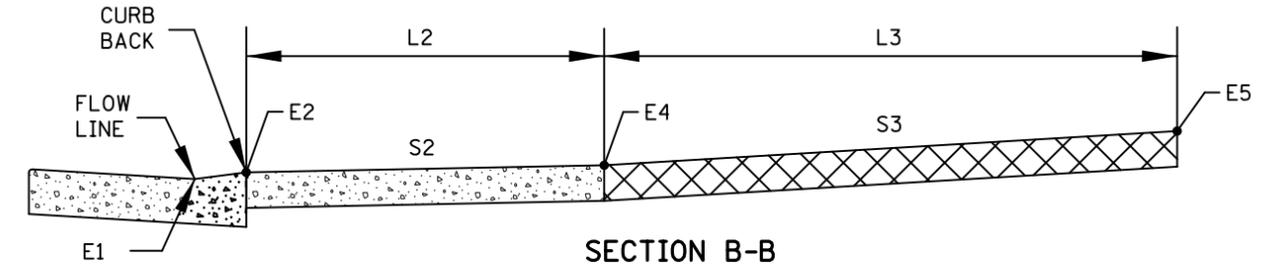


SECTION B-B
(REFER TO PREVIOUS SHEET)

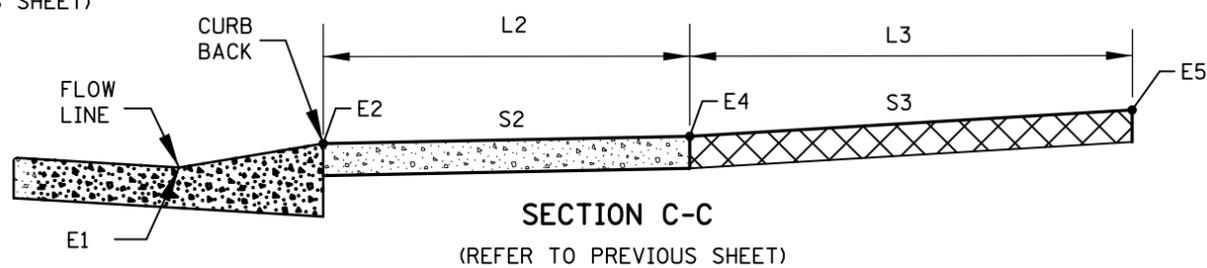


SECTION C-C
(REFER TO PREVIOUS SHEET)

DRIVEWAY TABULATION ①																
STATION	SIDE	DRIVEWAY TYPE	CURB TYPE ③	E1	E2	L1	S1	E3	L2	S2 ②	E4	L3	S3	EXISTING	E5	COMMENTS
						FT	%		FT	%		FT	%	%		

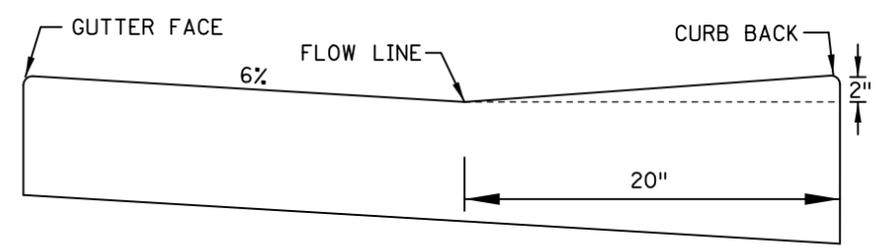

VG 220

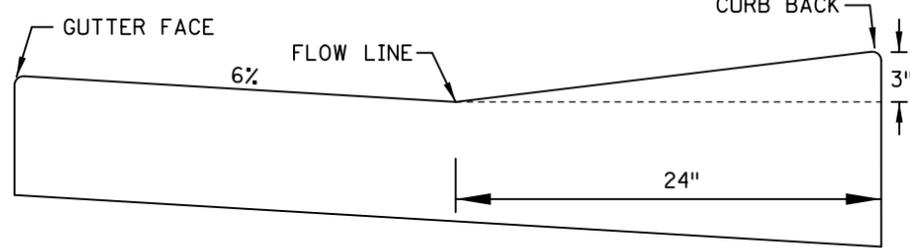

VG 324

VALLEY GUTTER CURB
OTHER CURB HEIGHTS & CURB APRON LENGTHS CAN BE USED

NOTES:








- DW CURB STANDARD SHALL BE USED WHEN THE DRIVEWAY ACTS AS A PEDESTRIAN RAMP. THE MAX. APRON SLOPE MUST ADHERE TO ADA CRITERIA AS WELL. DW CURB STANDARD SHOULD BE USED IF THERE IS ON STREET PARKING.
 - WHERE ROADWAY DRAINAGE IS A CONCERN (NEGATIVE SLOPED APRON) DW CURB TYPE 2 CAN BE USED TO HELP KEEP THE WATER ON PUBLIC RIGHT OF WAY.
 - S1 8% MAX PREFERRED, 10% MAX. COMMERCIAL AND 12% MAX. RESIDENTIAL. IF EXISTING GRADES ARE STEEPER DO NOT MAKE GRADES APPRECIABLY WORSE BY USING BEST PRACTICES SUCH AS DRIVEWAY CURB HEIGHTS, EXTENDING L3 AND/ OR STEEPEN S3.
 - DW CURB TYPE 3 SHALL ONLY BE USED IN EXTREME TIE-IN CASES.
 - S3 8% MAX PREFERRED, IF THIS SLOPE IS EXCEEDED OR IS CONTINUED FOR MORE THAN 5' ANALYZE THE NEED FOR VERTICAL CURVE(S). SEE ROAD DESIGN MANUAL, CHAPTER 5, FOR GEOMETRIC DESIGNS OF DRIVEWAYS.
- ① EXAMPLE SHOWN TO BE INCLUDED IN PLAN FOR EACH DRIVEWAY.
 - ② SHOULD BE DESIGNED AT 1.5%.
 - ③ DW CURB STANDARD SHALL BE THE STARTING POINT FOR ALL PERPENDICULAR AND TIERED DRIVEWAYS. DW CURB TYPES 2 AND 3 SHALL ONLY BE USED AFTER UTILIZING BEST PRACTICES SUCH AS MAXIMIZING S1, S3, AND L3.

REVISION:
 APPROVED: JANUARY 23, 2017
 OPERATIONS ENGINEER

REVISOR:
 APPROVED: 1-23-2017
 STATE DESIGN ENGINEER

DRIVEWAY AND SIDEWALK DETAILS
 STANDARD PLAN 5-297.254 2 OF 4

DISTRICT #: DISTRICT *
 USER NAME: \$\$\$@USER\$NAME\$\$\$
 PATH & FILENAME: Documents\Operations\ADA_Review\ADA_DesignGuidelines\ADA&space;Standard&space;Plates\2016&space;Cur&space;Ramp&space;Std.&space;

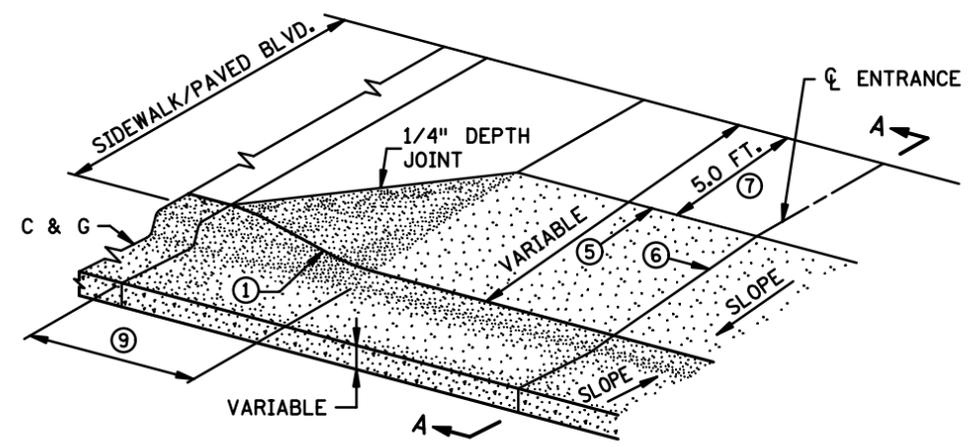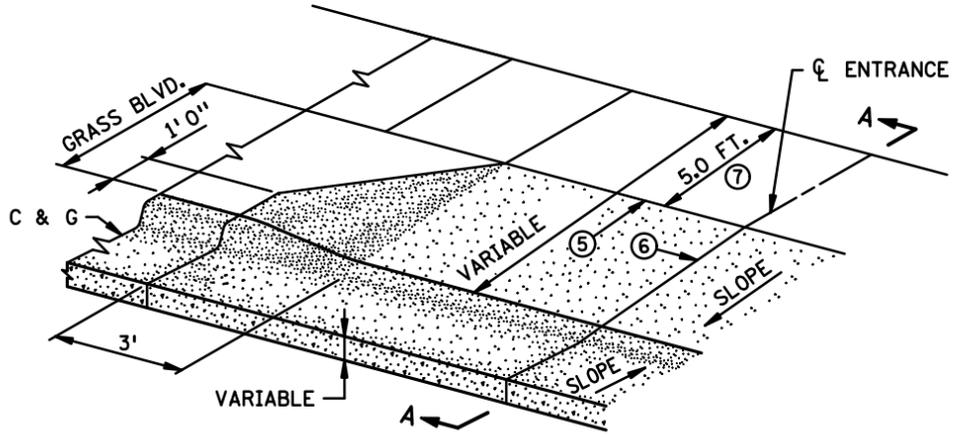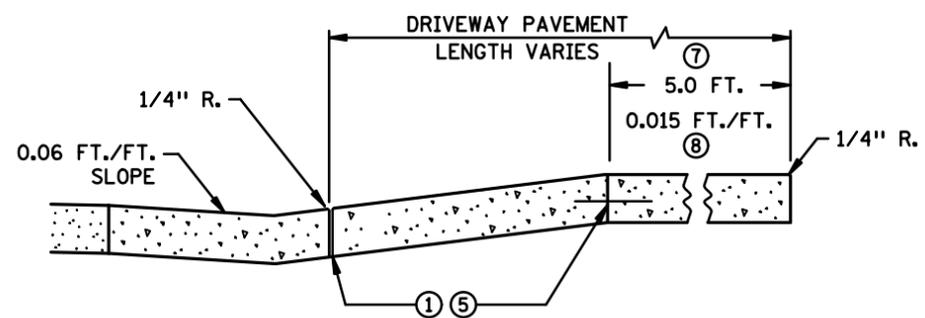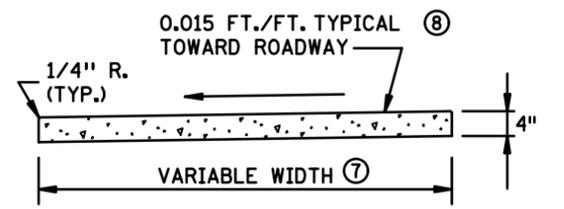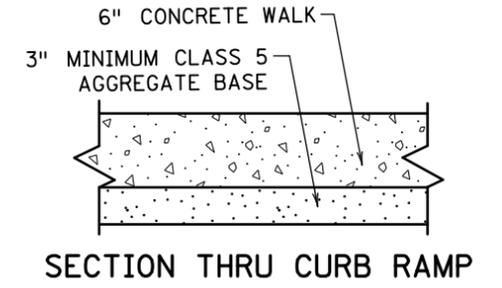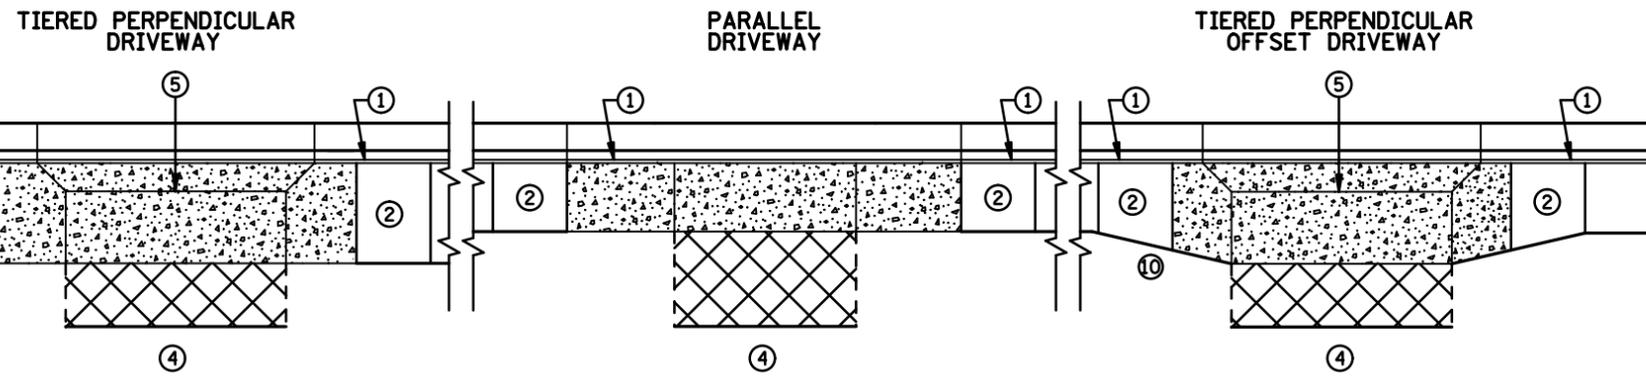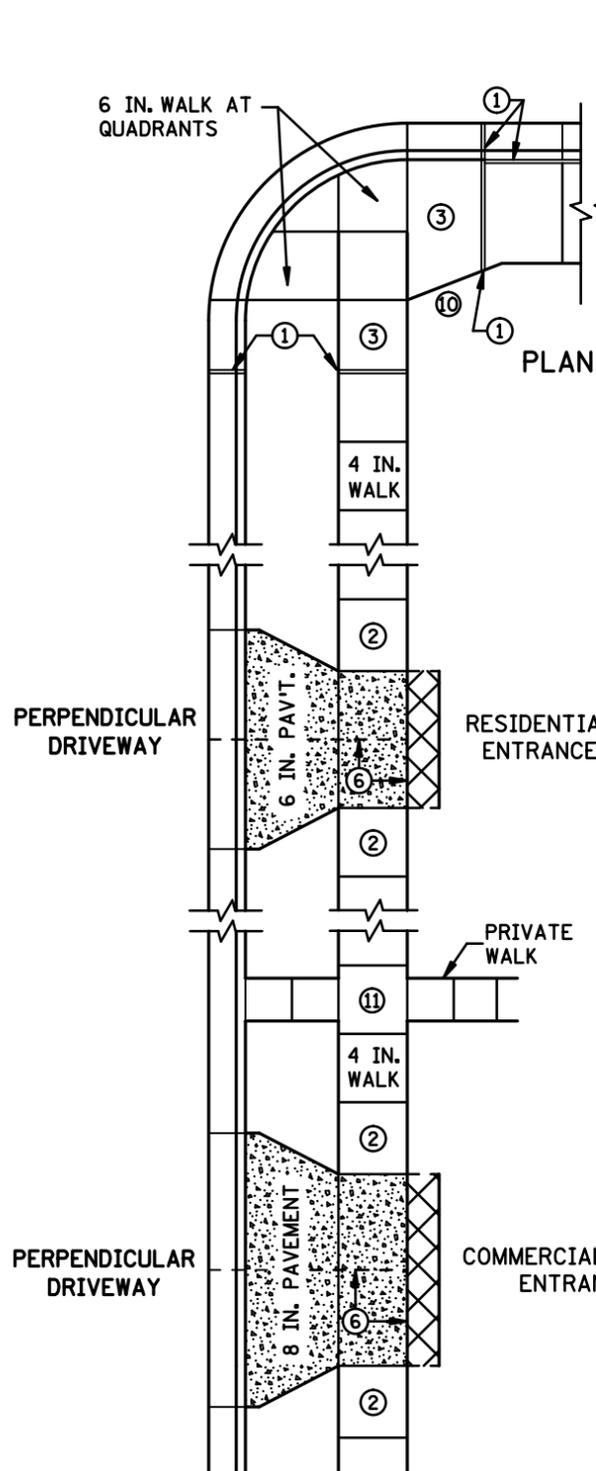

NOTES:

- TO MINIMIZE SIDEWALK "ROLLER COASTER" EFFECT IT IS DESIRABLE TO KEEP THE PAR ELEVATION CONTINUOUS OR AT LEAST IN THE UPPER HALF OF CURB HEIGHT. 4" HIGH CURB SHOULD BE USED INSTEAD OF 6" HIGH CURB TO HELP THIS PROBLEM WHEN APPLICABLE.
- 4" HIGH ADJACENT CURB IS PREFERRED WHEN BOULEVARDS 4' OR LESS ARE PRESENT MEASURED FROM THE BACK OF CURB. WHEN THE DRIVEWAY IS SLOPING DOWN FROM THE ROADWAY (NEGATIVE) 4" HIGH ADJACENT CURB SHOULD ALSO BE USED.
- SEE ROAD DESIGN MANUAL, CHAPTER 5, FOR GEOMETRIC DESIGN OF DRIVEWAYS.
- ① 1/2 IN. PREFORMED JOINT FILLER MATERIAL PER MnDOT SPEC. 3702, EXCEPT AT GRASS BOULEVARDS.
- ② TRANSITION DRIVEWAY THICKNESS TO WALK THICKNESS.
- ③ TRANSITION CURB RAMP THICKNESS TO WALK THICKNESS.
- ④ MATCH INPLACE DRIVEWAY WIDTH, MATERIAL TYPE AND THICKNESS.
- ⑤ TIE ONLY IF ADJACENT SECTIONS ARE NOT POURED MONOLITHICALLY. SEE SECTION A-A.
- ⑥ FORM CONTRACTION JOINT AS NEEDED TO PRODUCE APPROXIMATELY SQUARE PANELS (MAXIMUM WIDTH 15 FT. BETWEEN JOINTS).
- ⑦ 5.0' MIN. PAR WIDTH IS THE STANDARD THROUGH DRIVEWAYS. IF FEASIBLE WIDEN DRIVEWAY PAR WIDTH TO MATCH APPROACHING SIDEWALK PAR WIDTHS. IN VERTICALLY CONSTRAINED AREAS PAR WIDTHS CAN INCREMENTALLY BE REDUCED TO 4.5' OR 4' MIN AFTER ALL OTHER OPTIONS HAVE BEEN APPLIED.
- ⑧ THE PEDESTRIAN ACCESS ROUTE CROSS-SLOPE, SHALL NOT EXCEED 0.02 FT./FT. AS CONSTRUCTED.
- ⑨ 8% TO 10% FLARES SHALL BE USED WHEN ADJACENT TO WALKABLE SURFACES AND FOR ALL TIERED DRIVEWAYS WITH GRASS BOULEVARDS.
- ⑩ 1:10 MIN. SIDEWALK OFFSET TAPER REQUIRED FOR SIDEWALK REPLACEMENT PROJECTS. 1:3 MIN. AND 1:5 MIN. PREFERRED SIDEWALK OFFSET TAPER FOR DRIVEWAY REPLACEMENT.
- ⑪ LANDING REQUIRED, SEE NEXT SHEET FOR MORE INFORMATION.

REVISION:
 APPROVED: JANUARY 23, 2017


 OPERATIONS ENGINEER

REVISION:


 STATE DESIGN ENGINEER
 APPROVED:
 1-23-2017

DRIVEWAY AND SIDEWALK DETAILS
 STANDARD PLAN 5-297.254
 3 OF 4


DISTRICT #: DISTRICT *
 USER NAME: \$\$\$@USER\$NAME\$\$\$
 PATH & FILENAME: Documents/Operations/ADA_Review/ADA_DesignGuidelines/AD&space;Standard&space;Plates/2016&space;Cur&space;Ramp&space;Std.&space;

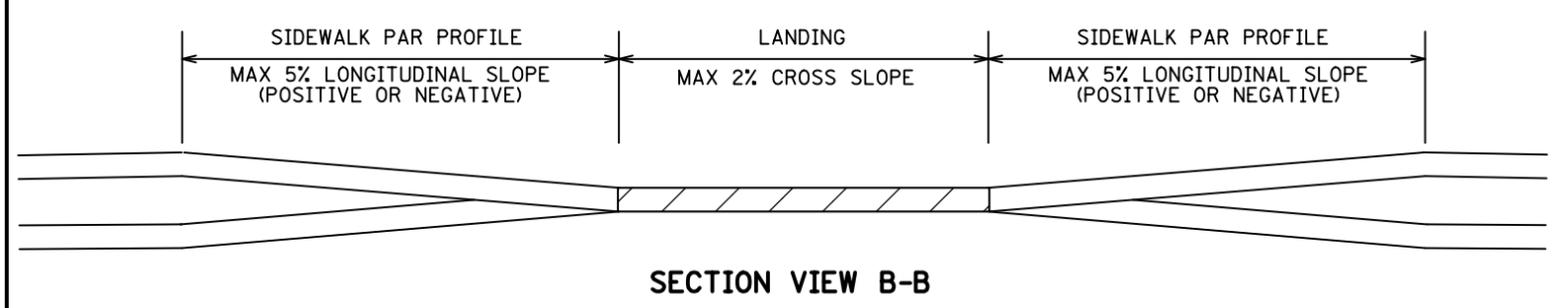


SECTION VIEW B-B

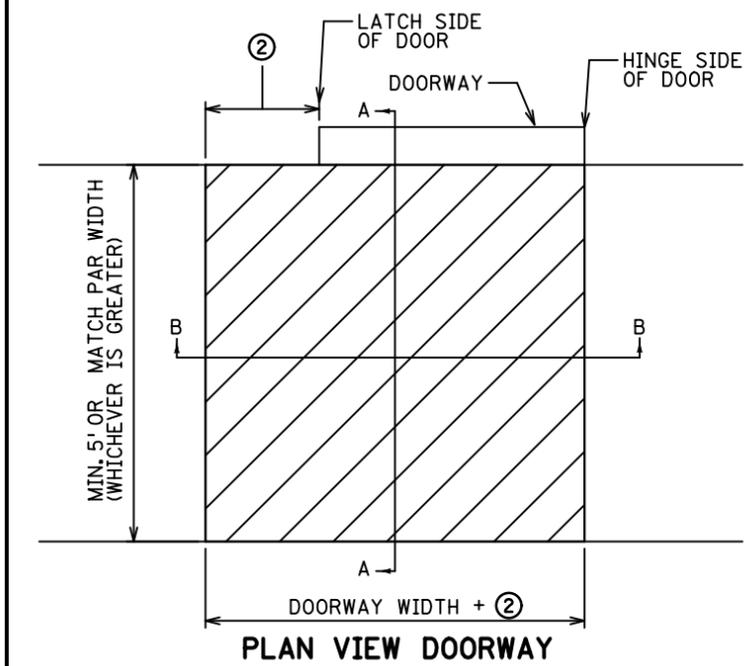


PLAN VIEW DOORWAY

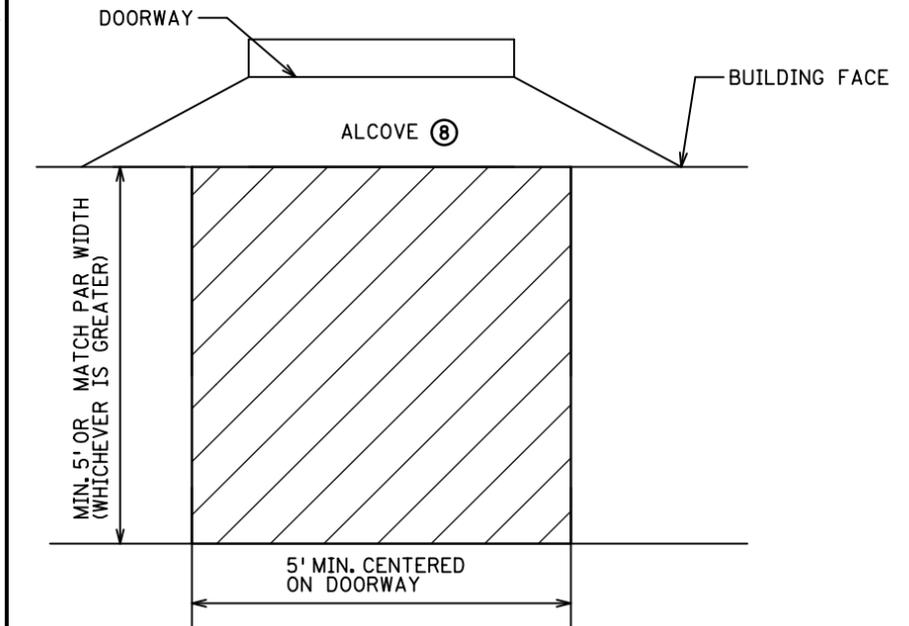


**PLAN VIEW DOORWAY WITH ALCOVE
SIDEWALK LANDING REQUIREMENTS ①**

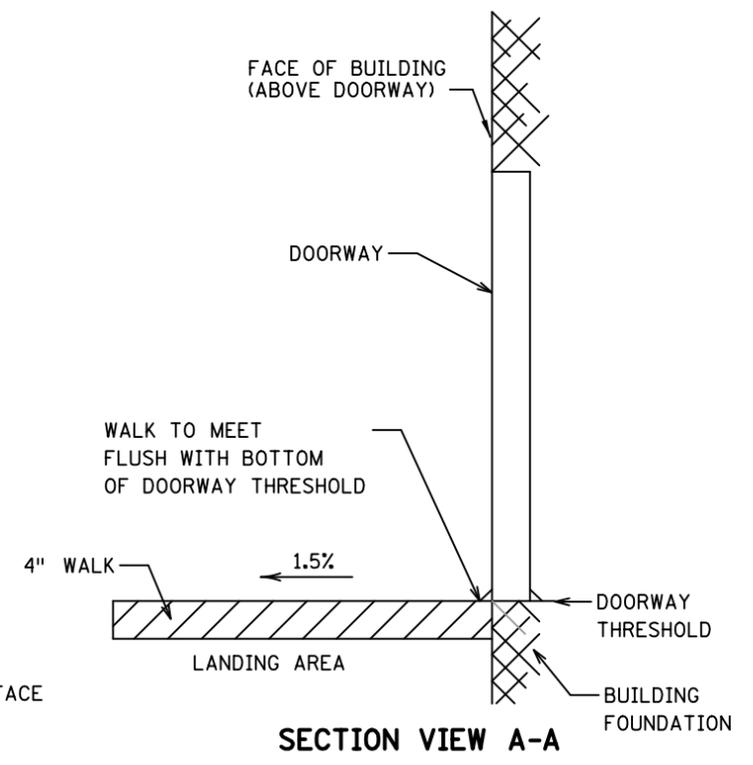

SECTION VIEW A-A

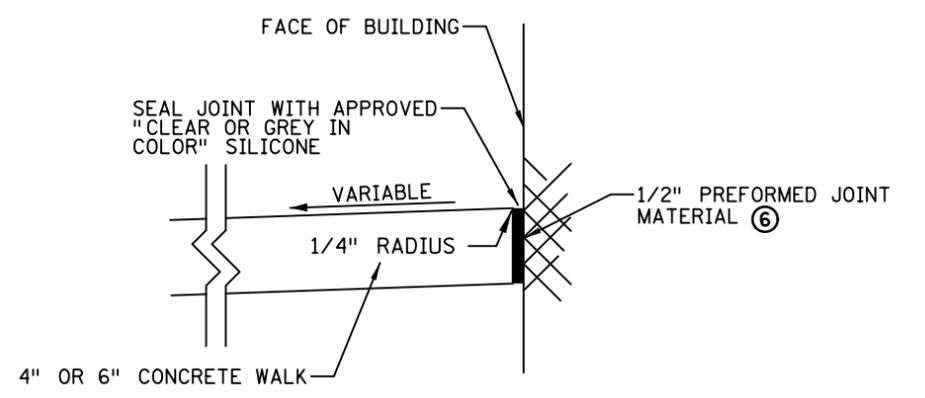

BUILDING JOINT SEAL (INCIDENTAL)

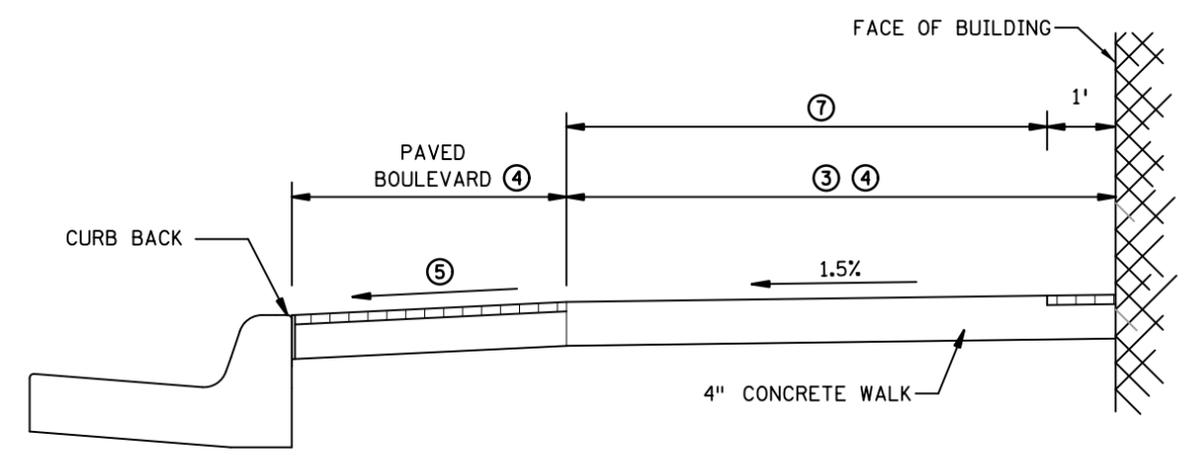

DOWNTOWN SIDEWALK TYPICAL SECTION

- NOTES:**
- FIELD ADJUST SIDEWALK PROFILES TO MEET ALL DOORWAY THRESHOLDS.
 - SIDEWALK MUST MAINTAIN POSITIVE DRAINAGE AWAY FROM THE BUILDING TO THE ROADWAY. SEE SPECIAL PROVISIONS FOR SILICONE SPECIFICATIONS.
 - ① LANDING CRITERIA IS REQUIRED FOR ALL DOORS, PRIVATE WALKS AND STEPS.
 - ② 18" MIN. WHEN DOOR SWINGS OUTWARD FROM BUILDING.
12" MIN WHEN DOOR SWINGS INWARD FROM BUILDING.
 - ③ 6' MIN. PAR REQUIRED WHEN ADJACENT TO BUILDINGS.
 - ④ 2/3 PAR TO 1/3 BOULEVARD SHOULD BE USED WHEN FEASIBLE.
 - ⑤ 1%-5% FOR THE MAJORITY OF THE BLOCK, WITH EXCEPTIONS UP TO 8% IN CONSTRAINED AREAS. 10% MAX. FOR SHORT SECTIONS ALLOWED TO ACCOUNT FOR FIELD TOLERANCES.
 - ⑥ FURNISH AND INSTALL BACKER ROD OF APPROPRIATE DIAMETER.
 - ⑦ TO MINIMIZE VIBRATION AND ROLLING RESISTANCE, AREA SHOULD BE FREE OF PAVERS, STAMPED CONCRETE, AND/OR EXCESSIVE JOINTING.
 - ⑧ 2% MAX. PER BUILDING CODE. IF GREATER THAN 2%, FLATTEN AS FEASIBLE.

LEGEND	
	LANDING - ALL SLOPES TO BE LESS THAN 2%
	OPTIONAL AESTHETIC TREATMENT

REVISION:
 APPROVED: JANUARY 23, 2017

 OPERATIONS ENGINEER

REVISOR:

 STATE DESIGN ENGINEER
 APPROVED:
 1-23-2017

DRIVEWAY AND SIDEWALK DETAILS
STANDARD PLAN 5-297.254
4 OF 4